

### Safety Information

>All electrical work must be undertaken by a qualified contractor to ensure compliance with latest edition BS7671 and IEE/IET wiring regulations.

> Before installing a Harlton Low Bay or doing any maintenance, ensure power supply is turned off at the circuit breaker or fuse box.

> This product is designed for permanent connection to fixed wiring; the circuit should be protected with the appropriate MCB or fuse.

### Environment

>Please DO NOT dispose of electrical items or packaging as unsorted waste. Use the recycling facilities provided by your local authorities.

### Non-replaceable light source

>The light source of this luminaire is not replaceable. When the light source reaches its end of life the whole luminaire shall be replaced.

## PRODUCT DIMENSIONS



All units are in mm

Low Bay	A	B	C	D
120W	600	320	52.5	98

With Emergency kit fitted

### Important Warranty Information

The Harlton Low Bay has a 3 year warranty, which can be extended free of charge to 5 years by registering online via the website address below. The registrant must provide the product part number and date of manufacture, which can be found on the label attached to the luminaire housing.



Certificate No. FS 590684



Certificate No. EMS 590685

NET LED Lighting  
Buckingway Business Park  
300 Anderson Road  
Cambridge  
CB24 4UQ  
sales@netled.co.uk  
www.netled.co.uk

Technical Helpline: 01223 851505  
Email: support@netled.co.uk

www.netled.co.uk/downloads

Distributed by



## LED LOW BAY INSTALLATION GUIDE

### LED LOW BAY NET-51-12-XX

Part Number	Description
NET-51-12-96	Harlton Low Bay - Standard
NET-51-12-86	Harlton Low Bay - Emergency
NET-51-12-99	Harlton Low Bay - Motion
NET-51-12-89	Harlton Low Bay - Motion Emergency




### SUPPLY/EARTH CLASS

100-240V AC 50/60 Hz  
Fig.1 Mains Input Termination



Class I

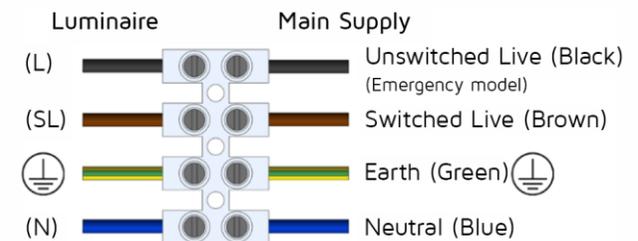

**Installation procedure:** Carefully read the installation instructions and ensure the mains supply is isolated before installation. Please follow the safety information overleaf before carrying out any installation. Please retain this leaflet for future reference.

**Low Bay Installation:**




Replaceable control gear by professional




Non-replaceable control gear


**Step 1:** Carefully remove the Low Bay and fixing bracket kit from the packaging.

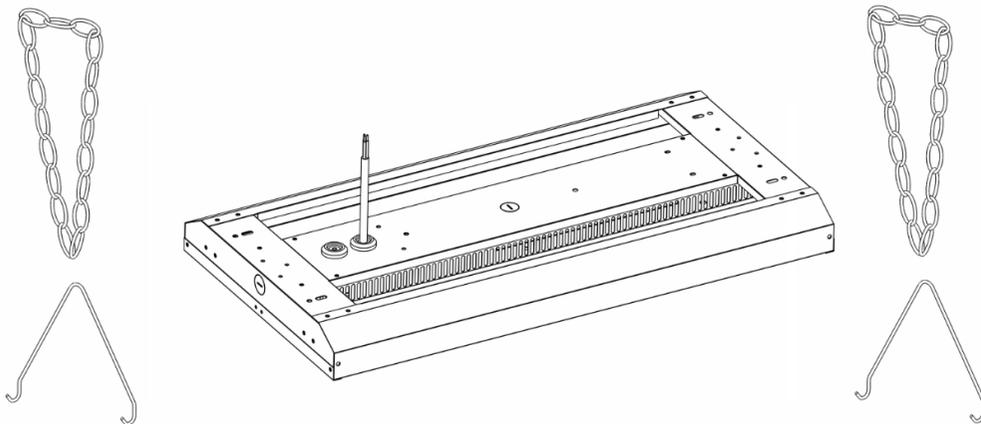


**Step 2:** Attach the chains to the support beam / mounting point. Then attach the metal hook to the chain ends. Insert the hook into the Low Bay housing.

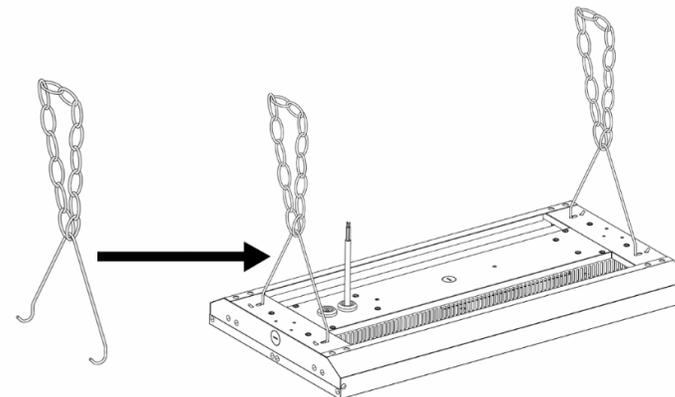


**Step 3:** Secure the supply cable using suitable clips. Ensure that the cable is not touching the body of the Low Bay light.

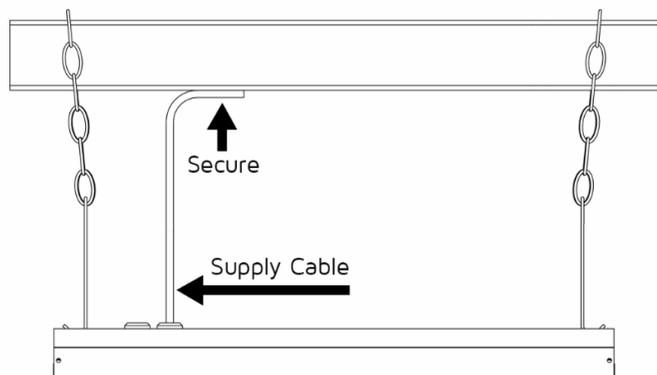

**Step 4:** Connect the cable to the mains as per the illustration below.

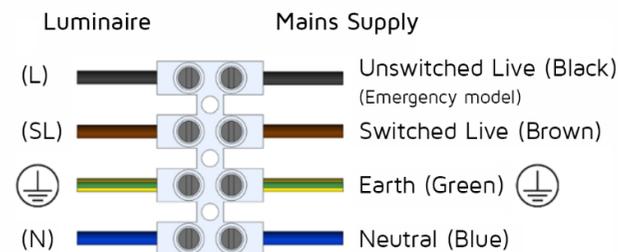


**Harlton Low Bay Emergency**

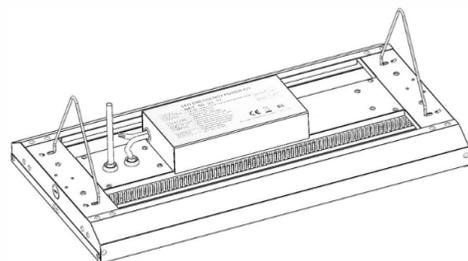

**Harlton Low Bay Motion Sensor**

Remote control required for Motion Sensor

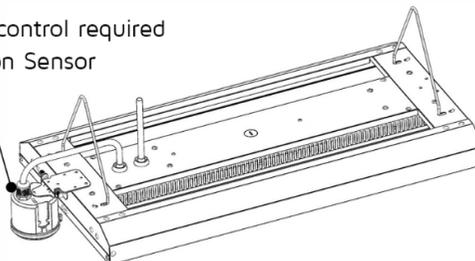

**Harlton Low Bay Motion Sensor Emergency**

Remote control required for Motion Sensor

