

Read these instructions before installation and retain for future reference. This equipment should be installed by a competent electrician



### Important Information

We recommend that luminaires are installed by a qualified electrician ensuring the installation complies with current IEE wiring regulations BS7671:2018 & local building control.

- All tests should be carried out in accordance to EN 50172:2004.
- BELL will not accept responsibility for any claims arising from a poor installation.
- The light source of this luminaire is not replaceable: when the light source reaches end of life, the whole luminaire must be replaced.
- Not suitable for petrochemical installations.
- Upgrading of MCB may be necessary
- 1 year warranty on battery
- Operating Temperature -30°C to +35°C, emergency versions 0°C to +35°C
- You are advised to test 5 samples before mass application of sensor in a new lighting project. The distance between any inductive sensors should be greater than 3m.
- Microwave maximum operating height 3.2m

**Warning Before installation ensure power is disconnected.**








This product may contain substances that can be hazardous to the environment if not disposed of properly. Electrical and electronic equipment should never be disposed of with general household waste but must be separated for its correct treatment and recovery. Where possible recycle your packaging.



Power	Voltage	CCT	CRT	lm	LED light Specification Source	L (mm)	W (mm)	H (mm)
20/40W	220-240 50/60Hz	3000/4000/6000	80	2800/5600	SMD2835	1263	93	90
25/50W	220-240 50/60Hz	3000/4000/6000	80	3500/7000	SMD2835	1563	93	90
30/60W	220-240 50/60Hz	3000/4000/6000	80	4200/8400	SMD2835	1828	93	90

IP65 CE

### Emergency

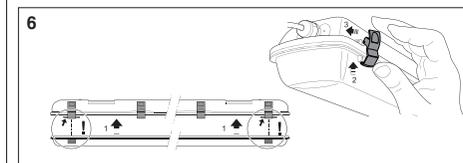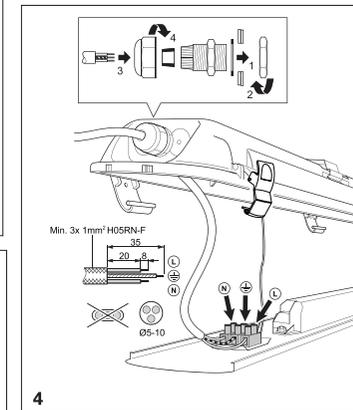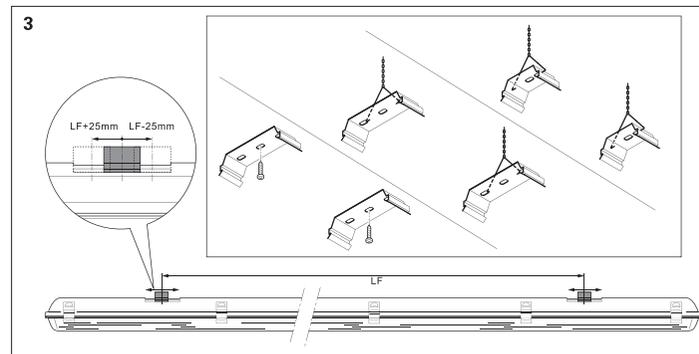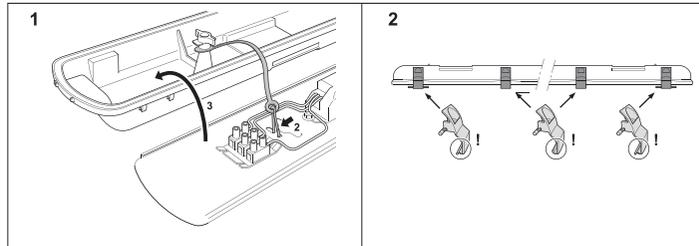

Technical Helpline +44 (0)1924 893380

www.bellighting.co.uk


British Electric Lamps Ltd  
Unit A Foxbridge Way, Normanton Industrial Estate  
Normanton, West Yorkshire. WF6 1TN

T: +44 (0)1924 893380 F: +44 (0)1924 894320 E: sales@bellighting.co.uk

www.bellighting.co.uk

Date	Revision
24.5.2022	2

Read these instructions before installation and retain for future reference. This equipment should be installed by a competent electrician

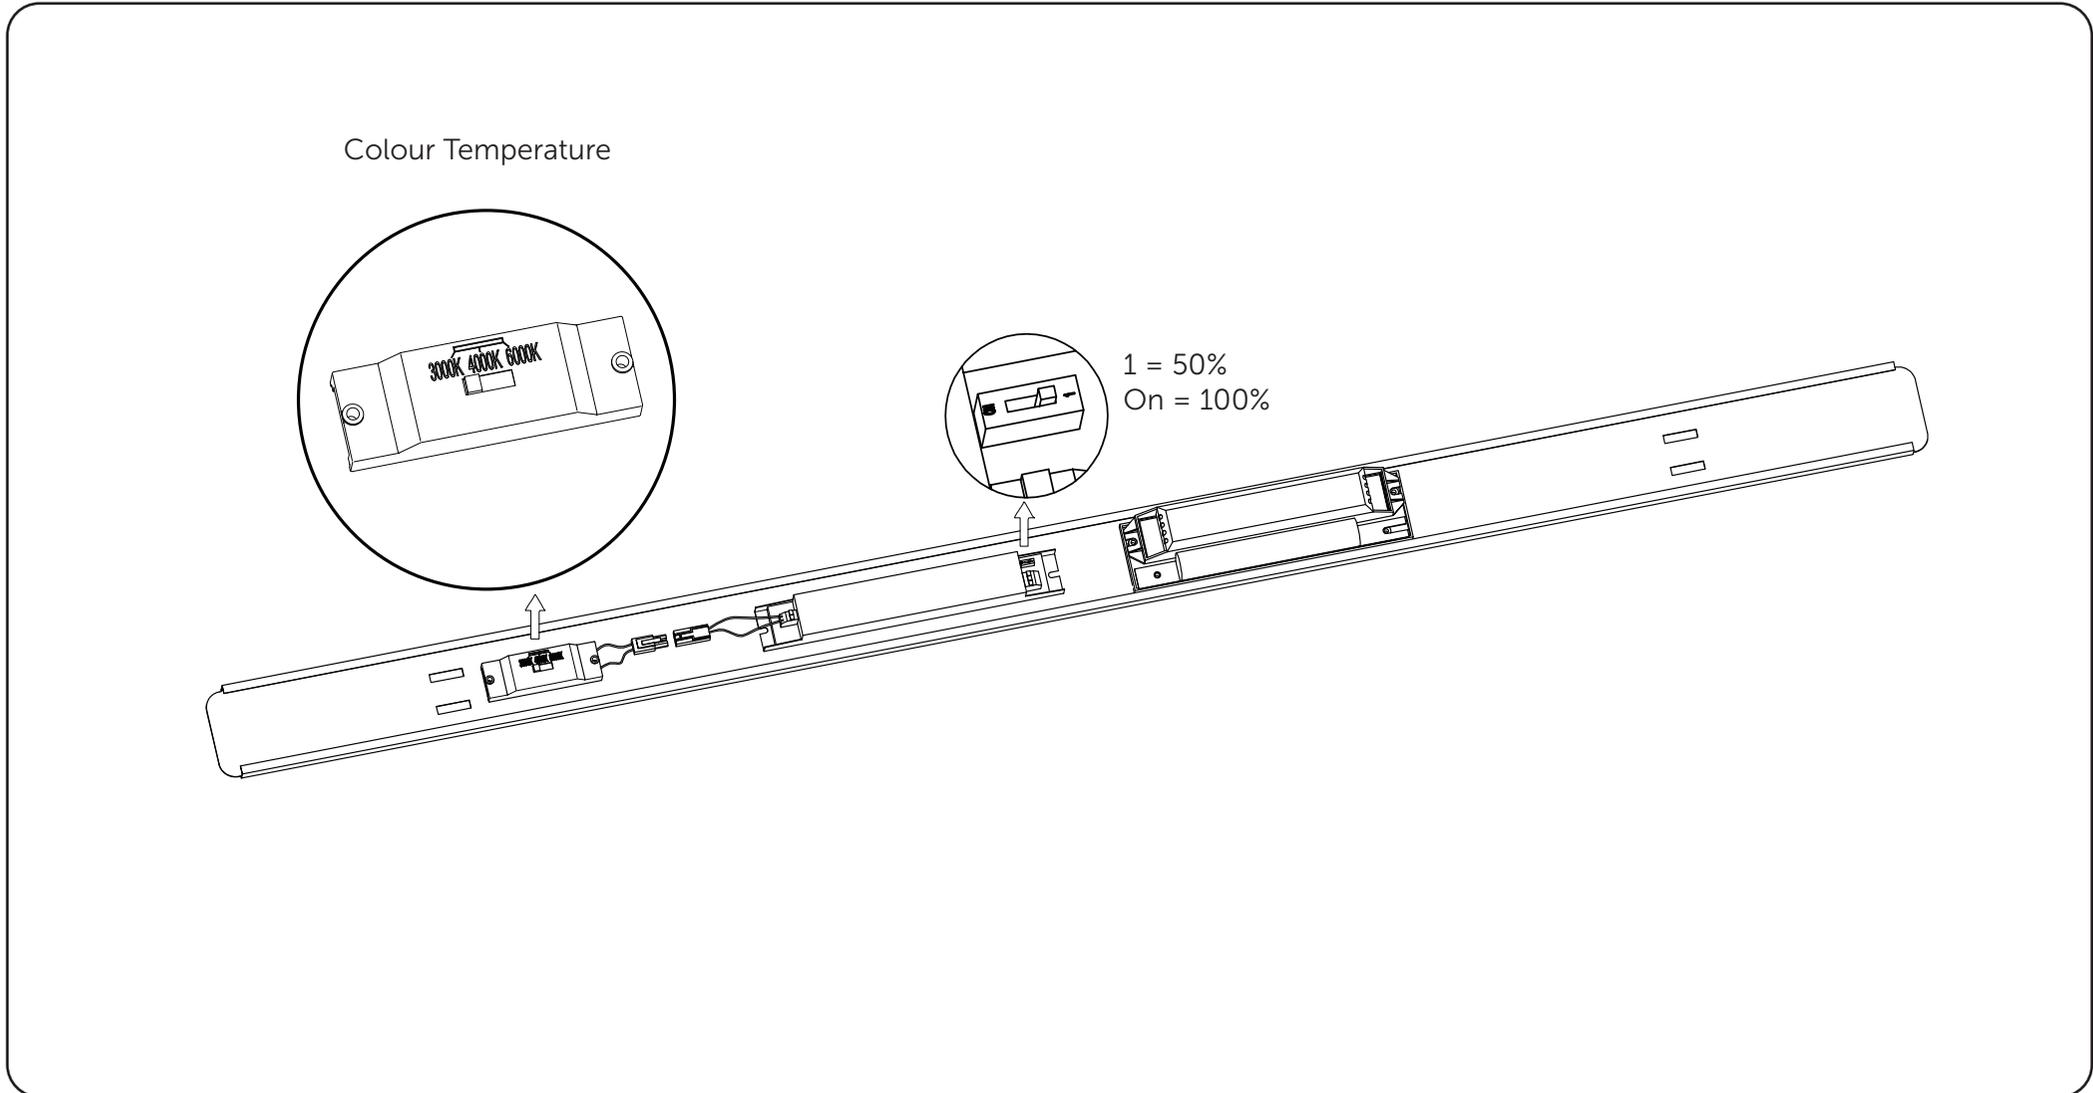

**Technical Helpline +44 (0)1924 893380**  
[www.bellighting.co.uk](http://www.bellighting.co.uk)

**British Electric Lamps Ltd**  
Unit A Foxbridge Way, Normanton Industrial Estate  
Normanton, West Yorkshire. WF6 1TN

T: +44 (0)1924 893380 F: +44 (0)1924 894320 E: [sales@bellighting.co.uk](mailto:sales@bellighting.co.uk)

[www.bellighting.co.uk](http://www.bellighting.co.uk)